

2 pieces stainless steel oxygen dry cleaned ball valve with full bore for Chemical industries, petrochemical industries, hydraulic installation, heating, water distribution, oxygen and compressed air.

PTFE packing and PTFE filled with 15% Glass fiber seat for a temperature up to +200°C.

 $Compatible\ with\ explosive\ atmosphere,\ ATEX\ Zone\ 1\&21\ and\ Zone\ 2\&22\ thanks\ to\ the\ antistatic\ device.$ 

Valve in accordance with the regulation (EC) N° 1935/2004.













Size: DN1/4" to DN2"

**Connection:** Female BSP

Min Temperature : -20°C Max Temperature : +200°C Max Pressure : 63 Bars

**Specifications:** For oxygen

PTFE filled with 15% glass fiber seat

Anti blow-out stem

ATEX

In accordance with the regulation EC 1935/2004

**Materials:** Stainless Steel EN 1.4408




#### **SPECIFICATIONS:**

- Valve in accordance with the regulation (EC) N° 1935/2004
- Full bore
- · Anti blow-out stem
- PTFE filled with 15% glass fiber seat
- Locking handle
- Atex
- Double antistatic device
- 2 pieces type
- Solid ball
- Dry cleaned for oxygen

#### USE:

- For oxygen
- Min and max Temperatures Ts: -20°C to + 200°C
- Max Pressure Ps: 63 bars ( see graph )

#### PRESSURE / TEMPERATURE GRAPH (STEAM EXCLUDED ) :

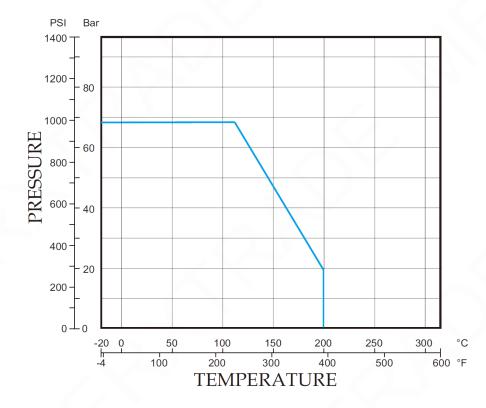

#### FLOW COEFFICIENT Kvs (M3/h):

DN	1/4"	3/8"	1/2"	3/4"	1"	1"1/4	1"1/2	2"
Kvs ( m3/h )	19	22	34	62	98	170	247	427



## TORQUE VALUES (in Nm without safety coefficient):

DN	1/4"	3/8"	1/2"	3/4"	1"	1"1/4	1"1/2	2"
Torque ( Nm )	3.5	4	5.5	7.5	11	15	20	40

## RANGE:


Dry cleaned stainless steel ball valve for oxygen Ref. 7143 from DN 1/4" to DN 2"

#### ENDS:

• Female / female threaded BSP cylindrical ends




## **MATERIALS:**

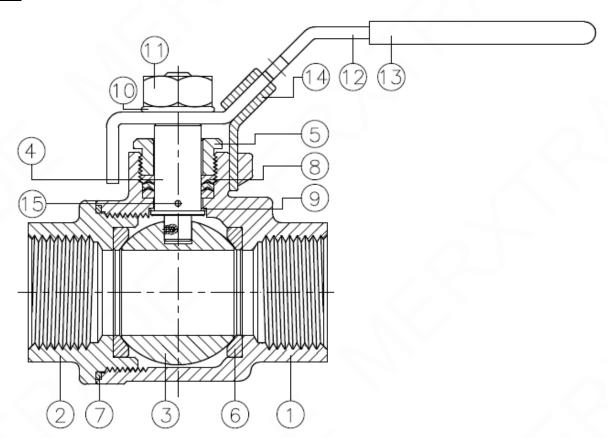

Item	Designation	Materials				
1	Body	/				
2	Ends	EN 1.4408				
3	Ball					
4	Stem	ASTM A276-316				
5	Packing nut	AISI 304				
6	Seat	PTFE filled with 15% glass fiber				
7	Body gasket					
8	Packing	PTFE				
9	Gasket					
10	Washer					
11	Handle nut	AISI 304				
12	Handle					
13	Handle cover	PVC				
14	Locking device	AISI 304				
15	Antistatic device	AISI 316				



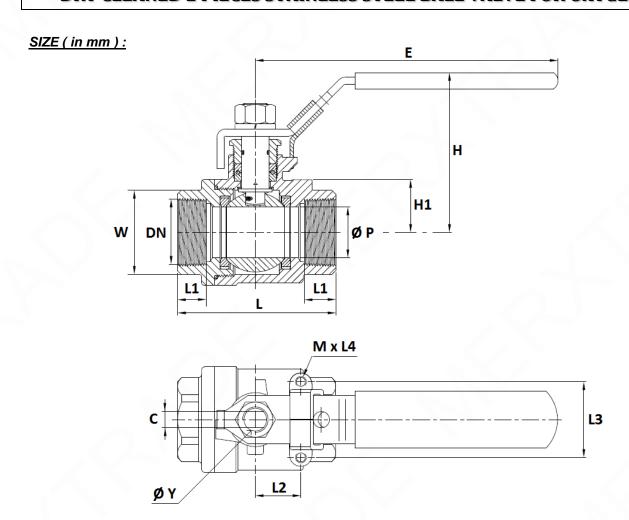

DN	1/4"	3/8"	1/2"	3/4"	1"	1"1/4	1"1/2	2"
ØΡ	11.6	12.5	15	20	25	32	38	50
L	50.8	50.8	58	65.6	78.7	90	105	124
L1	10	9	13	13	17	18	20	24
L2	12.7	12.7	12.7	12.7	22.4	22.4	23.2	23.2
L3	28.5	28.5	28.5	28.5	35	35	38.1	38.1
M x L4	M5 x 5.5			M5 x 6	M5 x 6.5	M6 x 5.5	M6 x 6	
E	100	100	100	125	149	149	190	190
Н	58.5	58.5	58.5	63.5	78	83	102	108
H1	15.8	15.8	15.8	21.3	23.8	30.5	35.5	44.3
С	5	5	5	6.5	8	8	10	10
ØΥ	9.5 (3/8"-24UNF)			11.1 (7/16"-20UNF)			12.7 (1/2"-20UNF)	
W (on flat)	19	23	26	32	38	49	54	67
Weight (Kg)	0.2	0.2	0.3	0.5	0.8	1.1	1.8	2.7
Ref.	714302	714303	714304	714305	714306	714307	714308	714309



#### **STANDARDS:**

- Fabrication according to ISO 9001 : 2015
- DIRECTIVE 2014/68/EU: CE N° 0035 Risk category III Module H
- Certificate 3.1 on request
- · Pressure tests according to API 598, table 6
- Female cylindrical BSP threaded ends according to ISO 7/1 Rp
- ATEX Group II Category 2 G/2D Zone 1 & 21 Zone 2 &22 (optional marking)
- Valve in accordance with the regulation EC 1935/2004 on request

**ADVICE :** Our opinion and our advice are not guaranteed and MXT shall not be liable for the consequences of damages. The customer must check the right choice of the products with the real service conditions.



# **INSTALLATION AND MAINTENANCE**

## **BEFORE INSTALLATION:**

Pipe-line must be cleaned and free from residual of weldings,rubbish,shaving and every kind of extraneous materials.

Pipe-line must be perfectly aligned and their support properly dimensioned so that there's no external constraint.

Please use the right product according to the services conditions to seal the valve.

Use the right bolt tightening so that the ends won't be damaged.



 For an installation in ATEX area, check the conductivity between the valve, the upstream pipe and the downstream pipe and make sure the pipe is connected to the earth.

#### **CLEANING AND TESTS**

Keep closed the valves during the cleaning operation so that there's no impurities between the ball and the body.

Tests under pressure must be done with a cleaned pipe-line.

Open partially the valve for tests. Pressure test do not exceed the valve specifications according to API 598.

#### MAINTENANCE

It's recommended to operate the valve twice (open and close) 1 to 2 times per year.

When intervention on the valve, be sure there's no pressure in the pipe-line, there's no fluid in it, and that it is isolated

The temperature must be low enough to operate without risks.

If there's a corrosive fluid, inert installation before intervention.

### When the valve is under pressure:

If there's a leakage at the packing, tighten it slightly so that the leakage disappears.